


MODEL NO	A	B	C	D	E	F	G	H	J	K	L	M	N	P	R	S	T	U	V	W	X	Y	Z	AA	BB	CC	DD	EE	FF	GG	**FA FILTER QUANTITY	**FA FILTER/HOOD QUANTITY	**RA FILTER QUANTITY	
12M	70	46	38	5.5	30	1	39.25	10.5	18.75	8.5	18.75	30.25	39.5	48	51.66	27	10	19	19	10	24	4.5	11.5	4.5	29.5	11.75	24.25	29.75	39.5	30		(4)20"x25"	(4)20"x25"	(4)20"x25"
15M	70	46	38	5.5	30	1	39.25	10.5	18.75	8.5	18.75	30.25	39.5	48	51.66	27	10	19	19	10	24	4.5	11.5	4.5	29.5	11.75	24.25	29.75	39.5	30		(4)20"x25"	(4)20"x25"	(4)20"x25"

- △A 80/20 BURNER PROFILE
- △B FC DWDI BLOWER
- △C LIFT-OFF INTAKE FILTER SERVICE DOOR
- △D DAMPER MOTOR
- △E ELEC/MANIFOLD CONTROLS VESTIBULE
- △F HINGED SERVICE DOOR
- △G MAIN DISCONNECT SWITCH
- △H SUPPLY FAN BLOWER MOTOR
- △J STANDARD FRESH AIR INTAKE HOOD/FILTER COMBINATION (FILTERS SUPPLIED ONLY WHEN ORDERED)
- △K FRESH AIR INTAKE FILTER
- △L FRESH AIR INTAKE DAMPER
- △M FRESH AIR INTAKE OPENING
- △N RETURN AIR INTAKE OPENING
- △P GAS CONNECTION
- △R LIFTING LUG
- △S DISCHARGE DAMPER
- △T DISCHARGE DIFFUSER
- △U RETURN AIR INTAKE FILTER
- △V RETURN AIR INTAKE FILTER SCREEN
- △W DISCHARGE LOCATOR FLANGE

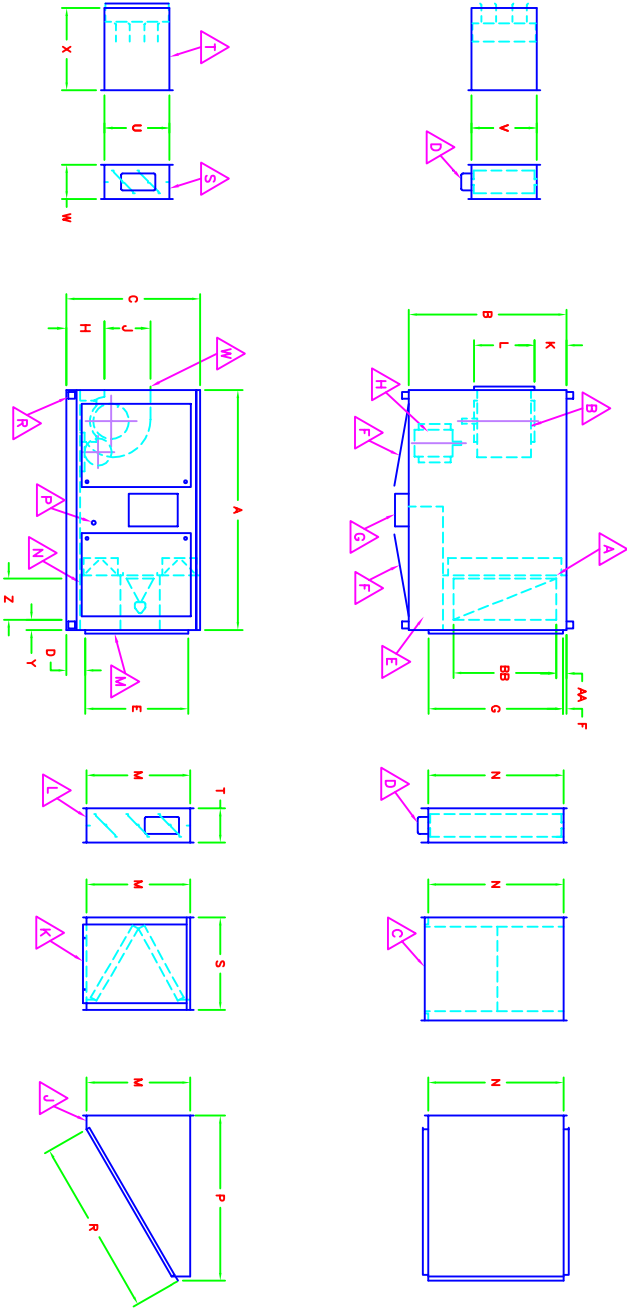

- NOTES:
- 1 INCH CONNECTION FLANGE SUPPLIED AROUND FRESH AIR INTAKE OPENING
 - (4) LIFTING LUGS AVAILABLE IN HANGING CONFIGURATION
 - DISCHARGE DIFFUSER SUPPLIED WITH ADJUSTABLE BLADES
 - GRIDDLE SUPPORT RECOMMENDED UNDER RETURN AIR INTAKE FILTER
 - BASE DESIGNED FOR FLAT MOUNT OR CURB MOUNT
 - **FA : FRESH AIR
 - **RA : RETURN AIR

RUPP AIR
MANAGEMENT SYSTEMS

DRAWN BY: TKL
DATE: 02/10/00

APPROVED BY: _____
DATE: _____

REVISIONS

REV	TITLE	REVISION DESCRIPTION

MATERIAL: _____

SCALE: 1 to 1

DO NOT SCALE DRAWING USE DIMENSIONS SHOWN
ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE SPECIFIED

RAM-12M AND 15M
ARRANGEMENT H4 HORIZONTAL DISCHARGE

ECN NO: _____
DWG: _____
DATE: _____

TOLERANCES

2 PLCS	±.03
3 PLCS	±.015

DRAWING/REV/PART NUMBER
30400054

30400054

REVISIONS

30400054