


MODEL NO	A	B	C	D	E	F	G	H	J	K	L	M	N	P	R	S	T	U	V	W	X	Y	Z	AA	BB	CC	DD	EE	FF	GG	**FA FILTER QUANTITY	**FA FILTER/HOOD QUANTITY	**RA FILTER QUANTITY	
12M	70	46	38	5.5	30	1	39.25	8.5	18.75	8.5	18.75	30.25	39.5	48	52.66	27	10	19	19	10	24	4.5	11.5	4.5	29.5	11.75	24.25	29.75	39.5	30		(4)20"x25"	(4)20"x25"	(4)20"x25"
15M	70	46	38	5.5	30	1	39.25	8.5	18.75	8.5	18.75	30.25	39.5	48	52.66	27	10	19	19	10	24	4.5	11.5	4.5	29.5	11.75	24.25	29.75	39.5	30		(4)20"x25"	(4)20"x25"	(4)20"x25"

- A** 80/20 BURNER PROFILE
- B** FC DWDI BLOWER
- C** LIFT-OFF INTAKE FILTER SERVICE DOOR
- D** DAMPER MOTOR
- E** ELEC/MANIFOLD CONTROLS VESTIBULE
- F** HINGED SERVICE DOOR
- G** MAIN DISCONNECT SWITCH
- H** SUPPLY FAN BLOWER MOTOR
- J** SHAMPOON/STERN ARRANGEMENT HOOD/FILTER COMBINATION (FILTERS SUPPLIED ONLY WHEN ORDERED)
- K** FRESH AIR INTAKE FILTER
- L** FRESH AIR INTAKE DAMPER
- M** FRESH AIR INTAKE OPENING
- N** RETURN AIR INTAKE OPENING
- P** GAS CONNECTION
- R** LIFTING LUG
- S** DISCHARGE DAMPER
- T** DISCHARGE DIFFUSER
- V** RETURN AIR INTAKE FILTER
- W** RETURN AIR INTAKE FILTER SCREEN

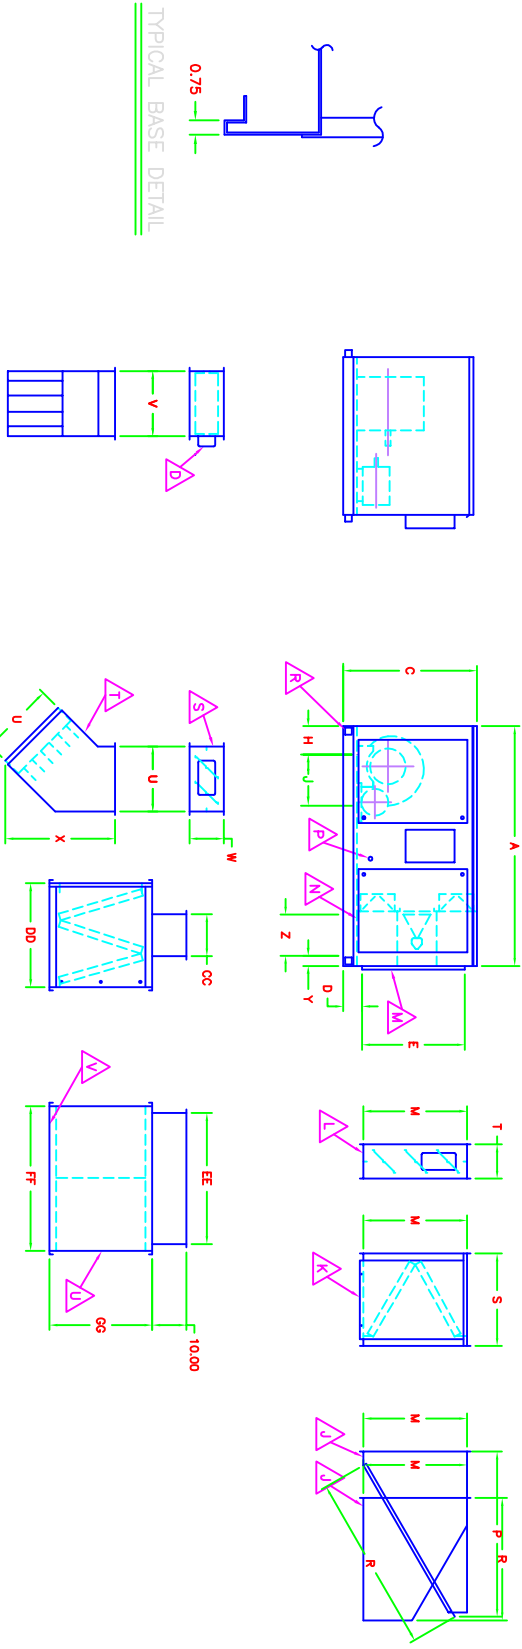

NOTES:

- 1 INCH CONNECTION FLANGE SUPPLIED AROUND FRESH AIR INTAKE OPENING
- 4) LIFTING LUGS AVAILABLE IN HANGING CONFIGURATION
- DISCHARGE DIFFUSER SUPPLIED WITH ADJUSTABLE BLADES
- GRADE SUPPORT RECOMMENDED UNDER RETURN AIR INTAKE FILTER
- BASE DESIGNED FOR FLAT MOUNT OR CURB MOUNT
- **FA : FRESH AIR
- **RA : RETURN AIR

RUPP AIR
MANAGEMENT SYSTEMS

DRAWN BY: TKL
DATE: 02/10/00

APPROVED BY: _____
DATE: _____

REVISIONS

REV	TITLE	REVISION DESCRIPTION

MATERIAL: _____

SCALE: 1 to 1

DO NOT SCALE DRAWING USE DIMENSIONS SHOWN
ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE SPECIFIED

RAM-12M AND 15M
ARRANGEMENT H5 DOWN DISCHARGE

ECN NO: _____
DWG: _____
DATE: _____

TOLERANCES

2 PLCS	±.03
3 PLCS	±.015